
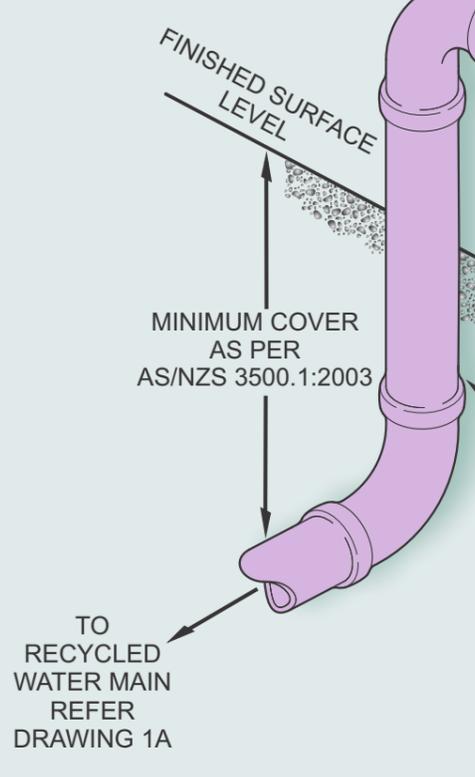
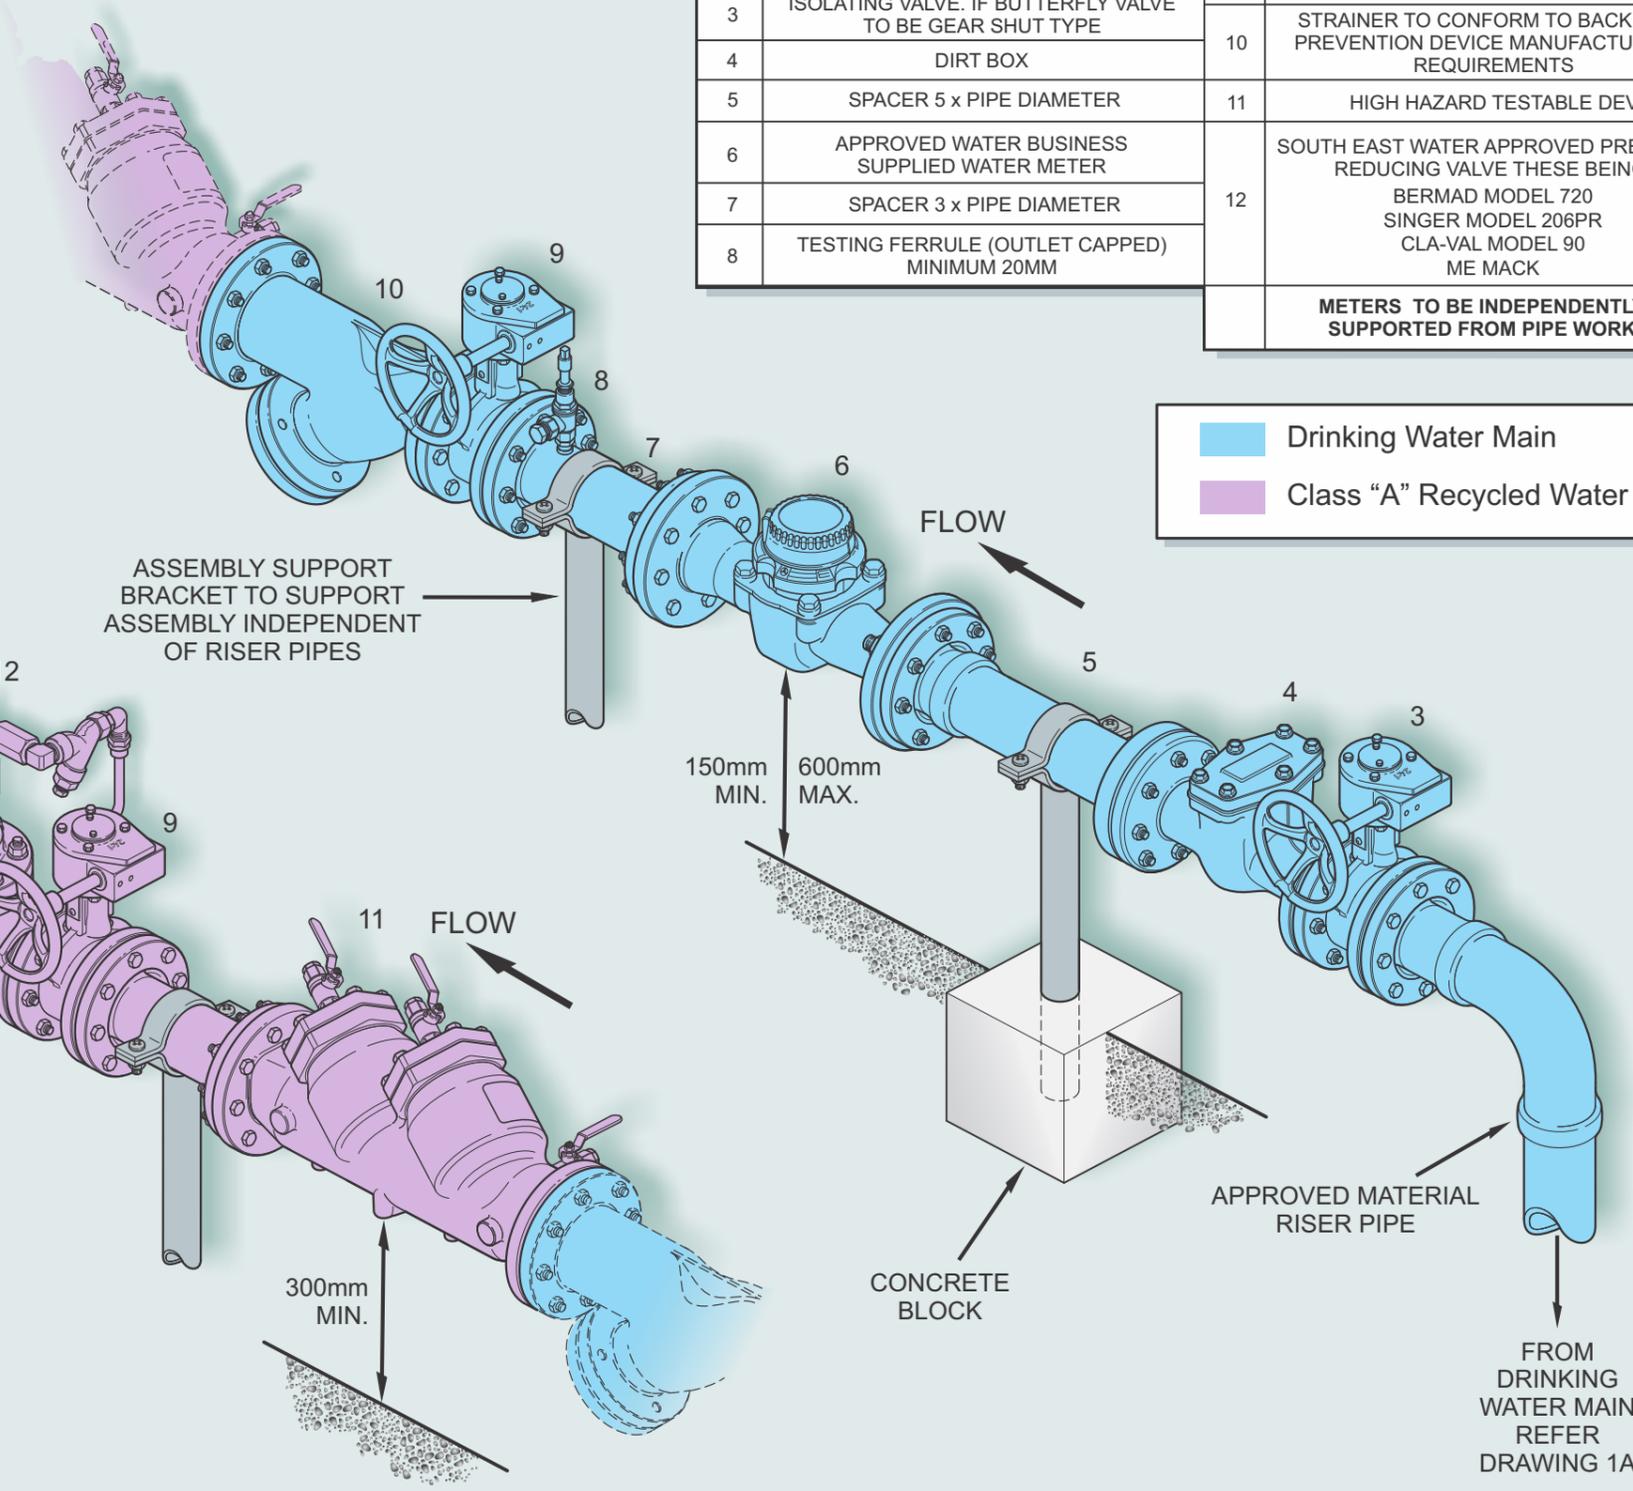


STANDARD LEGEND

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
┆	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
⌌	B.P.D.	High Hazard Testable Device
▶	P.R.V.	Approved Pressure Reducing Valve

SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 1A	9	RESILIENT SEATED ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE	10	STRAINER TO CONFORM TO BACKFLOW PREVENTION DEVICE MANUFACTURER'S REQUIREMENTS
4	DIRT BOX	11	HIGH HAZARD TESTABLE DEVICE
5	SPACER 5 x PIPE DIAMETER	12	SOUTH EAST WATER APPROVED PRESSURE REDUCING VALVE THESE BEING: BERMAD MODEL 720 SINGER MODEL 206PR CLA-VAL MODEL 90 ME MACK
6	APPROVED WATER BUSINESS SUPPLIED WATER METER		
7	SPACER 3 x PIPE DIAMETER		
8	TESTING FERRULE (OUTLET CAPPED) MINIMUM 20MM		METERS TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK

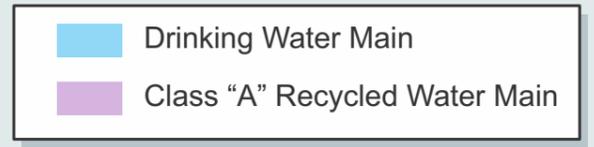

DRAWING NUMBER:
1

SCALE:
NOT TO SCALE

DATE:
AUG 2014

DUAL WATER INTERCONNECTION
TYPICAL ARRANGEMENT

