

STANDARDS (ABOVE GROUND FOI)

1. TRADE WASTE SPECIFICATION FOR CONNECTION TO SEWER.
2. A TRADE WASTE APPLICATION MUST BE SUBMITTED BEFORE WORK COMMENCES.
3. THE FOI SHALL HAVE A MINIMUM WATER CAPACITY AS SPECIFIED BY THE WATER AUTHORITY'S TRADE WASTE CONSENT/AGREEMENT.
4. THE RELEVANT COUNCIL HEALTH DEPARTMENT MAY HAVE CONDITIONS RELATING TO THE LOCATION OF THE FOI.
5. INSTALLATION TO BE IN ACCORDANCE WITH THE RELEVANT PLUMBING REGULATIONS.
6. THE FOI MUST BE INSTALLED BY A LICENSED PLUMBER AND A CERTIFICATE OF COMPLIANCE ISSUED BY THE PLUMBER.
7. EASE OF ACCESS FOR INSPECTIONS AND MAINTENANCE IS REQUIRED. THE ENTIRE INTERNAL CHAMBER MUST BE EASILY ACCESSIBLE AT ALL TIMES.
8. THE FOI SHALL NOT BE INSTALLED IN A CONFINED SPACE AS DEFINED BY THE WORKSAFE CODE OF VICTORIA.
9. THE INSTALLATION OF REMOTE SUCTION LINES MUST BE IN ACCORDANCE WITH THE WATER AUTHORITY'S GUIDELINES.
10. UNDERSIZED FOIS MAY NOT BE ACCEPTED.
11. ALL TRADE WASTE GENERATING FIXTURES AS TABLED IN THE WATER AUTHORITY'S SIZING CRITERIA MUST BE CONNECTED TO THE FOI.
12. ALL FOIS INSTALLED MUST COMPLY WITH THIS STANDARD DRAWING OR AS OTHERWISE VARIED BY THE EXPRESS PERMISSION OF THE WATER AUTHORITY.
13. NO ALTERNATE APPARATUS WILL BE ACCEPTED WITHOUT THE CONSENT OF THE WATER AUTHORITY.
14. SUPPORT PLATFORMS, LADDERS AND HANDRAILS MUST BE INSTALLED IN ACCORDANCE WITH RELEVANT STANDARD - FIXED PLATFORMS, WALKWAYS, STAIRWAYS AND LADDERS (AS1657).
15. GWW AREA: CONTACT GWW FOR CLARIFICATION OF WHEN TO USE, OR FOR ADDITIONAL INFORMATION.
16. BEFORE ANY TRADE WASTE APPARATUS IS INSTALLED IT MUST BE REVIEWED AND ACCEPTED BY THE SEW / YVW / GWW TRADE WASTE TEAM, AND SUBSEQUENTLY INCLUDED IN A TRADE WASTE AGREEMENT OR CONSENT.
17. USAGES: FOOD MANUFACTURE, FOOD PREPARATION.
18. ALL DIMENSIONS IN MILLIMETRES (MM) UNLESS SPECIFIED OTHERWISE.

FOR MORE INFORMATION CONTACT THE TRADE WASTE TEAM ON:
 SEW: 1300 634 112 OR TRADEWASTE@SEW.COM.AU,
 YVW: 1300 111 865 OR COMMERCIALCUSTOMERCARE@YVW.COM.AU,
 GWW: 134 499 OR TRADEWASTE@GWW.COM.AU

FROM FIXTURES
 PRESSURE PIPE TO FOI

50 VENT TO FREE AIR

VENTS MUST TERMINATE ABOVE THE ROOF LINE TO FREE AIR OR AS AGREED WITH THE WATER AUTHORITY. AIR ADMITTANCE VALVES NOT PERMITTED.

PUMP SUMP

INLET



WATER LEVEL

OUTLET

SECTION

PLAN

KEY DIMENSIONS

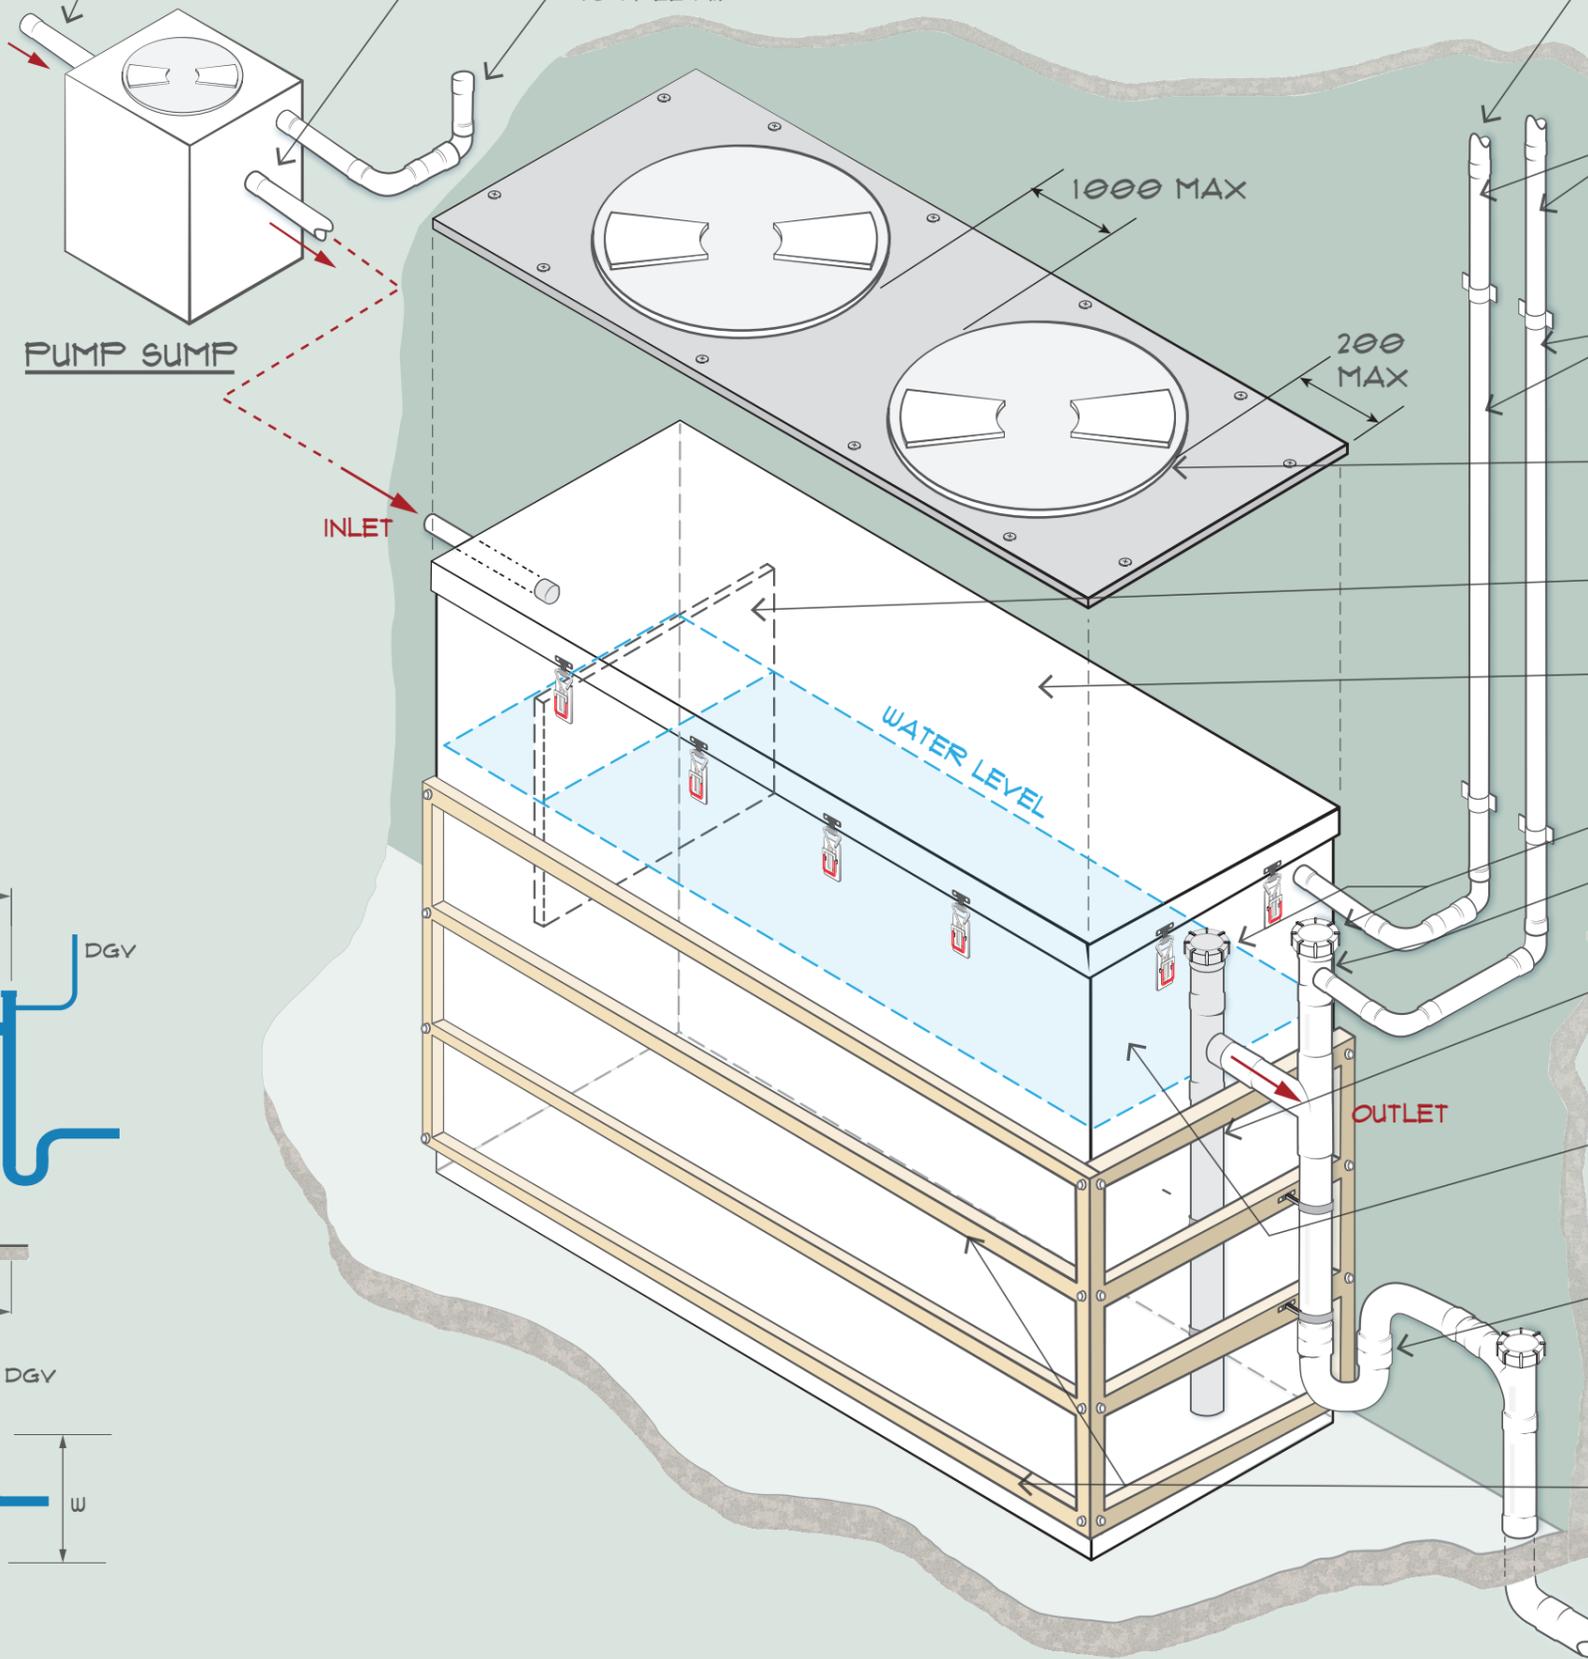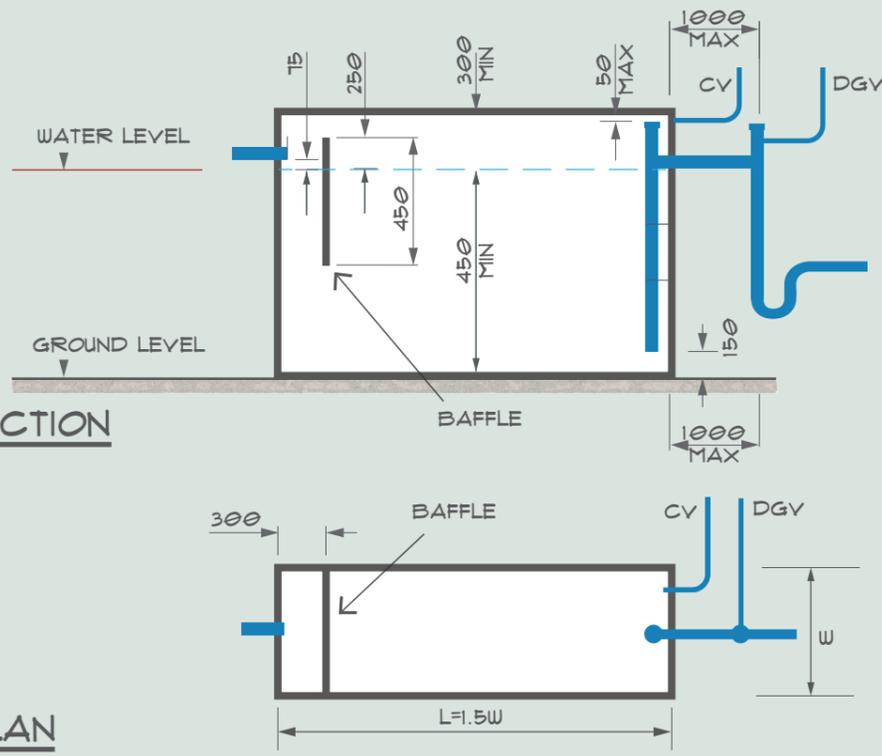

DRAWING NO:
AM 15

REVISION
3

SCALE
NTS

DATE
MAR 2025

FOOD AND OIL INTERCEPTOR (Grease trap) ABOVE GROUND INSTALLATION

