


SILT TRAP ASSEMBLY

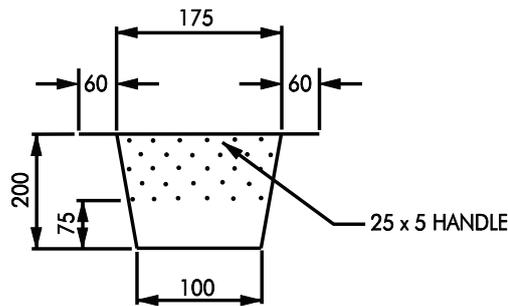

BASKET SPECIFICATION

Notes:

1. Trade waste specifications for connection to sewer.
2. Various silt trap designs are available. Consideration should be given to the appropriate silt trap design for the application.
3. Basket to be constructed of 3mm minimum thick mild steel plate with 5 rows of 10mm diameter holes at 25mm centres.
4. Basket to be galvanised after fabrication.
5. The silt trap must be constructed, installed, and connected in accordance with the relevant plumbing regulations.
6. Grate and basket must be fitted at all times when in use and regularly maintained to ensure correct ongoing functionality.
7. Disconnecter Gully required for sampling purposes.
8. GWW area; Contact GWW for clarification of when to use, or for additional information.
9. Before any trade waste apparatus is installed it must be reviewed and accepted by the SEW / YVW / GWW trade waste team, and subsequently included in a Trade Waste Agreement or Consent.
10. Usages; food manufacture, food preparation.
11. All dimensions in millimetres (mm) unless specified otherwise.

For more information contact the trade waste team on:

South East Water: **1300 634 712** or tradewaste@sew.com.au

Yarra Valley Water: **1300 771 865** or commercialcustomer-care@yvw.com.au

Greater Western Water: **134 499** or tradewaste@gww.com.au

Silt trap

DRAWING NO:

AM 13

REVISION:

2

SCALE:

NTS

DATE:

Aug 2025

South East
Water

Yarra
Valley
Water

Greater Western
Water