


## SECTION A - A

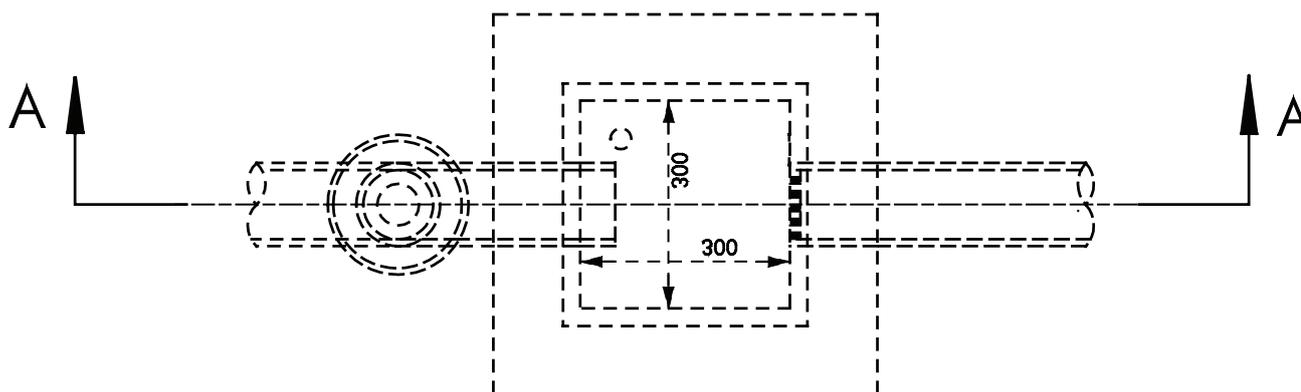

## PLAN

(cover removed)

### Notes:

1. Trade waste specifications for connection to sewer.
2. The test sump must be constructed, installed, and connected in accordance with the relevant plumbing regulations.
3. The test sump must be located in a position to provide ready access for maintenance, inspection, and sampling purposes.
4. The test sump shall be constructed from a material that is suitable for the quality of the waste.
5. The test sump and disconnector gully are required for sampling purposes.
6. GWW area; Contact GWW for clarification of when to use, or for additional information.
7. Before any trade waste apparatus is installed it must be reviewed and accepted by the SEW / YVW / GWW trade waste team, and subsequently included in a Trade Waste consent/agreement.
8. Usage; for sampling purposes downstream of trade waste treatment apparatus.
9. All dimensions in millimetres (mm) unless specified otherwise.

For more information contact the trade waste team on:

South East Water: **1300 634 712** or **tradewaste@sew.com.au**

Yarra Valley Water: **1300 771 865** or **commercialcustomercare@yvwm.com.au**

Greater Western Water: **134 499** or **tradewaste@gww.com.au**

## Test sump

DRAWING NO:

**AM 11**

REVISION:

**2**

SCALE:

**NTS**

DATE:

**Aug 2025**

South East  
Water

Yarra  
Valley  
Water

Greater Western  
Water